





Table of Contents

Table of Contents	. Page 1
Approvals	. Page 1
Attention	. Page 1
Specification	. Page 2
Model Description & Part Number	. Page 2
Mounting	. Page 3
Wiring	. Page 3
Operation	. Page 4
Operation & Adjustment	. Page 4
Installation Position	. Page 4
Maintenance & Testing	. Page 5
Accessories & Replacement	. Page 6



Approvals



UL Listed: UL 353 File # MH 16628



CSA Certified: CSA C22.2 No. 14 Certification File # 201527



FM Approved: Class 3510, 3530

File # J.I. 1Y919.AF

Commonwealth of Massachusetts Approved Product Approval code G3-0106-191

Attention



The installation and maintenance of this product must be done under the supervision of an experienced and trained specialist. Never perform work if gas pressure or power is applied, or in the presence of an open flame.



Check the ratings in the specifications to verify that they are suitable for your application.



Please read the instruction before installing or operating. Keep the instruction in a safe place. You find the instruction also at www. dungs.com. If these instructions are not heeded, the result may be personal injury or damage to property.



On completion of work on the pressure switch, perform a leakage and function test.



Any adjustment and applicationspecific adjustment values must be made in accordance with the equipment manufacturers instructions.

IFGC UL ANSI NFPA This product is intended for installations covered by, but not limited to, the following codes and standards: NFPA 86, ANSI Z83.4/CSA 3.7, ANSI Z83.18/CSA 4.9, ANSI Z21.13, CSD-1, UL 795, CSA B149.1 or CSA B149.3

Explanation of symbols

1, 2, 3 ... = Action

= Instruction

Specification

GAO-A4, GMH-A4, GML-A4 High/low ventless gas pressure switch (SPDT) with automatic or manual reset. Includes visual indication of switch position.











Max. Operating Pressure MOP = 7 PSI (500 mbar)



Electrical Connection Screw terminals via 1/2" NPT conduit connection



Ag-Contact Rating (Silver) 10 A resistive @ 120 VAC 3 A inductive @ 120 VAC 1 A @ 12 - 48 VDC

Au-Contact Rating (Gold) max 20 mA @ 24 VDC Ideal for low voltage & current applications.



Enclosure NEMA Type 4 **Ambient / Fluid Temperature** Versions

-2, -3, -4, -5 & -6; -40 °F to +140 °F; (-40 °C to +60 °C) . Versions -8; -20 °F to +140 °F;

Gases

(-30°C to +60 °C)

Dry, natural gas, propane, butane; other noncorrosive gases. Suitable for up to 0.1% by volume, dry H₂S. A "dry" gas has a dew point lower than +15 °F and its relative humidity is less than 60 %.

Materials in contact with Gas Housing: Aluminum & Steel Diaphragm: NBR-based rubber

Vent Limiter

Incorporates a vent limiter as per UL 353 and limits the escape of gas less than 1.0 CFH of natural gas at 7 PSI if internal switch diaphragm rupture. No vent line required, when accepted by the authority having jurisdiction.

Model Description & Part Number					
Туре	Version	Order No.	Setting range in. W.C.	Switching hysteresis in. W.C.	Factory Calibration
GAO-A4 pressure switch	GAO-A4-4-2 GAO-A4-4-3 GAO-A4-4-5 GAO-A4-4-6 GAO-A4-4-2 Gold GAO-A4-4-3 Gold GAO-A4-4-5 Gold GAO-A4-4-6 Gold GAO-A4-4-8 Gold	217-090A 217-091A 217-092A 217-093A 217-094A 223-525A 222-267A 222-268A 222-269A 223-526A	0.16 - 1.20 0.40 - 4.00 2.00 - 20.00 12.00 - 60.00 40.00 - 200.00 0.16 - 1.20 0.40 - 4.00 2.00 - 20.00 12.00 - 60.00 40.00 - 200.00	≤ 0.12 ≤ 0.20 ≤ 0.40 ≤ 1.2 ≤ 4.0 ≤ 0.12 ≤ 0.20 ≤ 0.40 ≤ 1.2 ≤ 4.0	† 4]
GMH-A4 pressure switch	GMH-A4-4-4 GMH-A4-4-6 GMH-A4-4-8 GMH-A4-4-6 Gold GMH-A4-4-6 Gold	217-326A 217-327A 217-328A 222-270A 222-271A	1.00 - 20.00 12.00 - 60.00 40.00 - 200.00 1.00 - 20.00 12.00 - 60.00	 	† ①
GML-A4 pressure switch	GML-A4-4-4 GML-A4-4-6 GML-A4-4-8 GML-A4-4-4 Gold	217-340A 217-341A 217-342A 222-272A	1.00 - 20.00 12.00 - 60.00 40.00 - 200.00 1.00 - 20.00	 	ţΦ
All switches with Silver contacts have 120 VAC neon lights factory installed All switches with Gold contacts have 24 V lights factory installed					

Mounting

Recommended Mounting Procedure

- 1. Use new, properly reamed and threaded pipe free of chips.
- 2. Apply good qulaity pipe sealant, purring a moderate amount on the male threads only. If using LP gas, use pipe sealant rated for use with LP gas.
- 3. Use 13/16" Wrench to secure the switch to the pipe.

Do not exceed 177 lb-in of torque

4. After installation is complete, perform a leak test.


Venting is NOT required, subject to the authority having jurisdiction. The switch has a built in vent limiter.

Wiring


Wiring Procedure

- 1. Remove the clear cover from the switch.
- 2. Use 14 or 16 AWG wire rated for at least 75 °C
- 3. Route the wires through the conduit connector.
- 4. Install a conduit plug at some point in the conduit run between the switch and closest panel that contains switching contacts or other sparking devices (see NFPA 86 requirements about potential risks of gas leaking down conduit).
- 5. Connect the wiring to the appropriate screw terminals.


GMH High Gas Switch (Operating state shown) As pressure rises above setpoint, 2 NO closes, 1 NC opens, and Neon light ON (fault), switch trips and locks out.



Wiring terminal illustration




GAO Low or High Gas Switch (Operating state shown as a high limit). As pressure rises above set point, 1 NC opens, 2 NO closes, Neon light ON (fault). As pressure falls below set point, switch resets: 1 NC closes and 2 NO opens, Neon light off.



GML Low Gas Switch (Operating state shown)

As pressure falls below setpoint, 2 NO opens, 1 NC closes, Neon light ON (fault), switch trips and locks out.



Λ

All wiring must comply with local electrical codes, ordinances and regulations.




Do not exceed the switch ratings given in the specifications and on the switch.

Operation

Definition of switching hysteresis ∆p

The pressure difference between the upper and lower switching pressures.

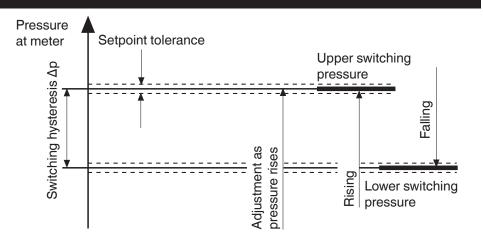

Operation & Adjustment

Annually check the switch for proper operation **Set Point Calibration**

The set point dial of the GAO and GMH is factory calibrated with increasing pressure (GML: decreasing pressure). Due to hysteresis, the GAO switch will actuate at a slightly lower point as the pressure decreases.



Adjusting the Set Point

- 1. Remove the clear cover **1** from the switch.
- 2. Turn the dial **9** until the desired trip pressure is opposite the white arrow (mark) on the yellow dial face.
- 3. After adjusting the set point for normal operation check to see that the gas pressure switch operates as intended.
- 4. Use an accurate pressure gauge connected upstream from the switch to measure the actual pressure.
- 5. Replace the clear cover.

Automatic Reset

The NC contact of the GAO breaks when pressure rises above the set point. It makes automatically when pressure returns to the normal operating level.

Manual Reset

The NC contact of the GMH breaks when pressure rises above the set point. The NO contact of the GML breaks when pressure falls below the set point. Neither of the switches will return to their former position automatically. To reset, wait until the pressure returns to the normal operating level. Then press and release the clear cover over the red reset button in the center of the yellow dial face; it is not necessary to remove the cover. The neon light indicates a fault condition for the GML and GMH series and for the GAO series when used as a high gas limit. The lead for the light wired to terminal #2 on 😑

Note: Always calibrate the switch in mounting position	n the desired a high gas limit. The lead for the light wired to terminal #2 on the GAO series should be wired to terminal #1 when used as a low gas limit.		
Installation Position	10 To 200		
Standard in	nstallation position is vertical upright diaphragm.		
	When installed horizontally , the pressure switch switches at a pressure higher by approx. 0.2 in. W.C.		
	When installed upside down , the pressure switch switches at a pressure lower by approx. 0.2 in. W.C.		
	alled in other positions , the pressure switch switches at pressure deviating from erence value by max. ± 0.2 in. W.C.		

Annually check the switch for proper operation

Low Gas Pressure Switch:

- First, connect a meter capable of reading +/- 0.1 ohms to the NO and COM contacts, and verify that the NO and COM contacts are made. Measure the resistance, and if the resistance is more than 1.0 ohm, remove switch from service. (See terminal illustration below for guidance).
- 2. Then, verify that the low gas pressure switch will change state when a low gas condition is sensed by connecting a meter capable or reading +/- 0.1 ohms to the NC and COM contacts and then by causing the switch to go into a fault condition. Once the fault occurs, Measure the resistance, and if the resistance is more than 1.0 ohm, remove switch from service.
- 3. To cause the fault, perform one of the two procedures:
 - 1. Turn the pressure switch setpoint counterclockwise until the switch trips.
 - 2. Depressurize the volume of gas the low gas pressure switch is sensing. For FRI/6 regulators, this can be done by opening the side tap on the oppositive side of the FRI/6 regulator. For DMV and MBC safety shutoff valves, this can be done opening the port 1 pressure tap. For SV valves, open port 1 of the upstream valve.
- Allow the burner to go through a startup sequence, and then verify that the burner faults and is not allowed to light off.
- 5. Close all test taps (ports) and open upstream ball valve.
- 6. When finished, close all pressure test points used, and then open the upstream ball valve **SLOWLY** to allow gas pressure to gradually bleed into the system.



Opening the upstream ball valve too fast can permanently damage the pressure switch.




Do not similate fault conditions while the burner is firing.



- First, connect a meter capable of reading +/- 0.1 ohms to the NC and COM contacts, and verify that the NC and Measure the resistance, and if the resistance is more than 1.0 ohm, remove switch from service.
- Then, verify that the high gas pressure switch will change state when a high gas condition is sensed by connecting a meter capable of reading +/- 0.1 ohms to the NO and COM contacts and then by causing the switch to go into a fault condition.
- 3. To cause the fault, perform one of the two procedures:
 - 1. Turn the pressure switch setpoint clockwise until the switch trips.
 - 2. Pressurize the volume of gas the high gas pressure switch is sensing. This can be done by closing the downstream ball valve, opening port 3 tap on a DMV and MBC safety shutoff valves, or port 2 or 3 of the downstream SV valve, and then using a pump to pressurize the test chamber.
- 4. Measure the resistance across the NO and COM contacts. If the resistance is more than 1.0 ohm, remove switch from service.
- Allow the burner to go through a startup sequence, and then verify that the burner faults and is not allowed to light off
- 6. When finished, close all test taps (ports) and open the downstream ball valve.

NOTE: A resistance of more than 1.0 ohm indicates that the switch contacts are starting to either corrode or carbonize.

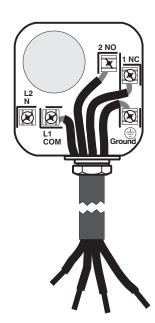



Accessories & Replacement				
Accessory for pressure switch	Order No.			
Replacement cover (screws not included)	228-732 (for GAO switches) and 233-113 (for GMH and GML switches)			
Screw for replacement cover (100 pcs.)	237-675			
PG 11 - 1/2" NPT conduit adapter (10 pcs)	231-214			
PG 11 - 1/2" NPT conduit adapter (1 pcs)	220-566			
120 VAC light mounting set (orange)	231-772			
120 VAC light only (standard)	244-156			
24 VDC/VAC light mounting set (orange)	231-774			
120 VAC light mounting set (green)	248-240			
DIN connector (female plug)	210-318			
Male plug for DIN connector	219-659 (for GAO switches) and 227-644 (for GMH and GML sitches)			
Mounting bracket (metal)	230-289 (optional mounting bracket)			

We reserve the right to make modifications in the course of technical development.



Karl Dungs Inc.
3890 Pheasant Ridge Drive NE
Suite 150
Blaine, MN 55449, U.S.A.
Phone 763 582-1700
Fax 763 582-1799
e-mail info@karldungsusa.com
Internet http://www.dungs.com/usa/

Karl Dungs GmbH & Co. KG P.O. Box 12 29 D-73602 Schorndorf, Germany Phone +49 (0)7181-804-0 Fax +49 (0)7181-804-166 e-mail info@dungs.com Internet http://www.dungs.com