


SW2, SW2-US Auxiliary Switch Kit for HVAC Damper Actuators MNXX20, MNXX34, MSXX10A, MSXX20A

INSTALLATION INSTRUCTIONS


1 100 Vac, 5 (3) A M25331	2 M25332	3 (MSXX05A, MSXX10A, MSXX20A) M25333
4 100 Vac, 5 (3) A M25331	5 24 V + 24 V ✓ M25335	6 M25336
7 M25337	8 AS1 A — S3 B — S1 S2 AS2 S6 — C S4 — D S5 M25338	9 Setting AS1, AS2 M25339

10 Setting AS1 (e.g. to 30°)

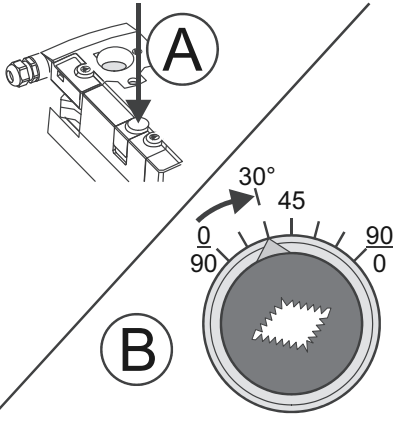


M25340

11

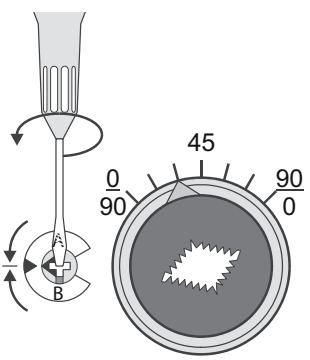


M25341

12 Result (10 + 11)

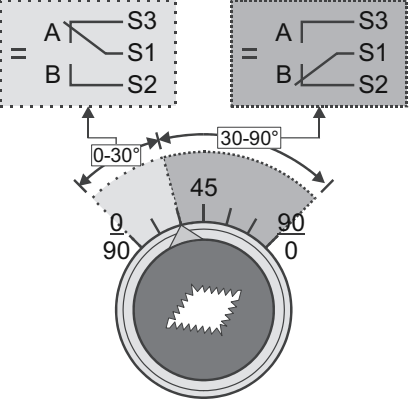


M25342

13 Setting AS2 (e.g. to 75°)

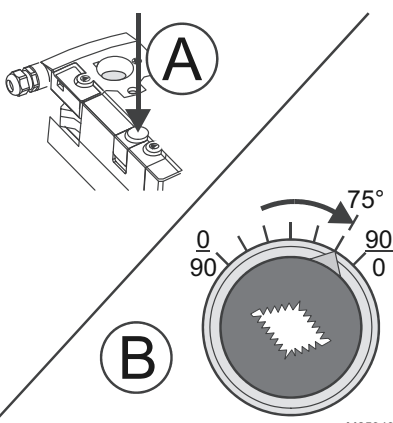


M25343

14

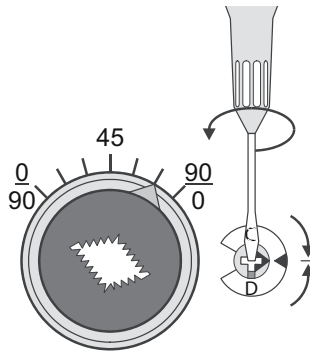


M25344

15 Result (13 + 14)

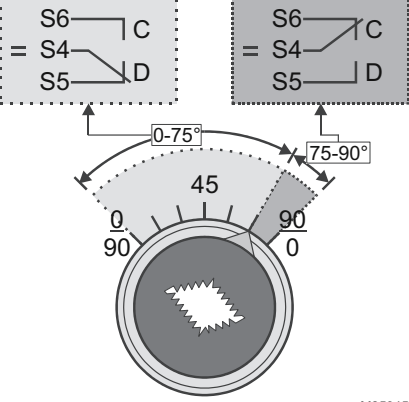

M25345

16

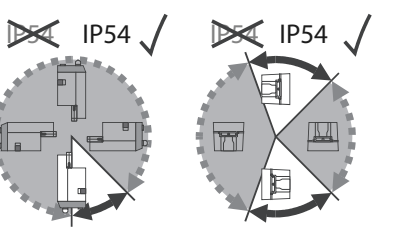

M25346

E resultsetting e. g. to

D ergebniseistellen z. b. auf

DKresultatjustering f. eks

ESresultadoajuste e. g. en

F résultatajustment p. a. au

I risultatoaggiustaggiop. e. in

N resultatjustering f. eks

NLresultatinstellen b. v.

S resultatinställning ex.

FI tulos aseta esim

By using this Honeywell literature, you agree that Honeywell will have no liability for any damages arising out of your use or modification to, the literature. You will defend and indemnify Honeywell, its affiliates and subsidiaries, from and against any liability, cost, or damages, including attorneys' fees, arising out of, or resulting from, any modification to the literature by you.

Automation and Control Solutions
Honeywell International Inc.
1985 Douglas Drive North
Golden Valley, MN 55422
customer.honeywell.com

© U.S. Registered Trademark
© 2011 Honeywell International Inc.
62-0259—03 M.S. Rev. 10-11
Printed in United States

Honeywell